

Halton Exe Tough Rectangular (ETR) – Fire damper (EI 120 S)



Overview

This is the one of the largest rectangular fire damper in the market. Minimum free space around its body is needed in case of installation. It is suitable for both vertical and horizontal installation in concrete, masonry or lightweight structures. Installation option up to 1.0 meter away from the structure (EI 90 S) has been certified. Fire resistance class is provided up to EI 120 S requirements.

Features

- Supplied with electrical spring return actuator (24 V or 230 V), or mechanical spring release (failsafe)
- Sizes from 800×700 mm up to 1500×800 mm are available
- Maximum air velocity through fire damper in open position is 12 m/s
- Suitable for use in ducts with a maximum pressure difference of 1200Pa
- Frame construction is galvanised steel as standard. Stainless steel option available on request.
- No spare parts or additional installation frames needed, regardless of installation method

Installation options

- Suitable for vertical (wall) and horizontal (ceiling/floor) installation
- Can be installed up to 1.0 m away from the separate element i.e. floor or ceiling (EI 90 S)
- CE marked for installation in concrete, masonry or lightweight structures with fire resistance

classes of EI 120, EI 90 or EI 60


- Limit switch(es) available as an accessory for mechanical spring release (failsafe)

Standards

This product complies with the following standards:

- CE certified according to product standard EN 15650
- Fire classification according to EN 13501-3+A1 standard
EI 120 (v_e h_o i↔o) S, EI 90 (v_e h_o i↔o) S, EI 60 (v_e h_o i↔o) S
- Fire testing according to EN 1366-2
- CE certificate of constancy of performance No: 1391-CPR-2018/0201
- Declaration of Performance No: 10032-ETR-2019/01/01
- Leakage through closed damper blade fulfils class 2 according to EN 1751
- Damper casing tightness class C according to EN 1751
- Corrosion resistance: Salt mist test EN 60068-2-52

Dimensions and Weight

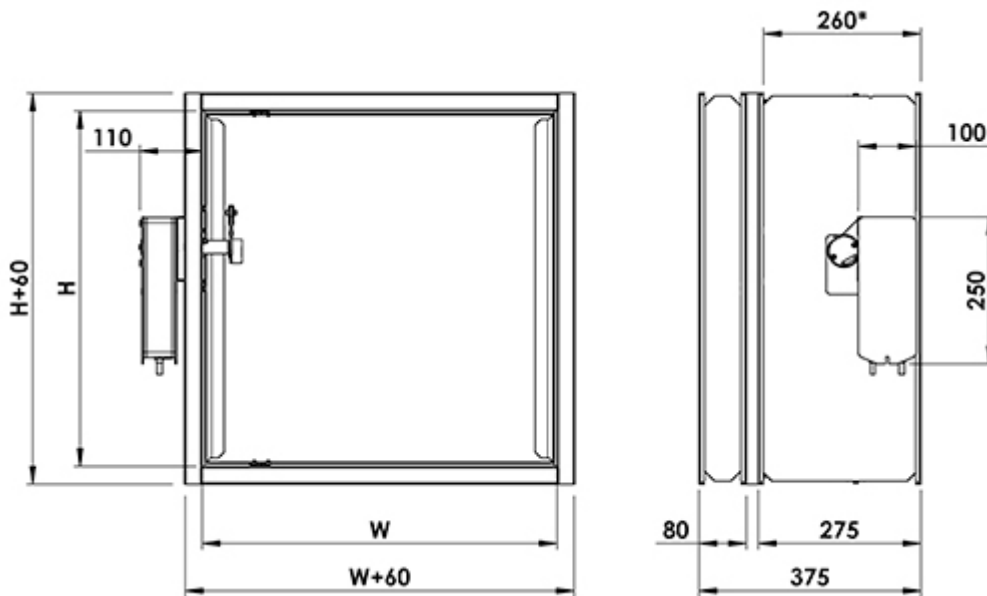

W = Width


800, 900, ... 1500 mm

H = Height

600, 700, 800 mm

* Space reservation for fire damper

Overlap of blade (mm)

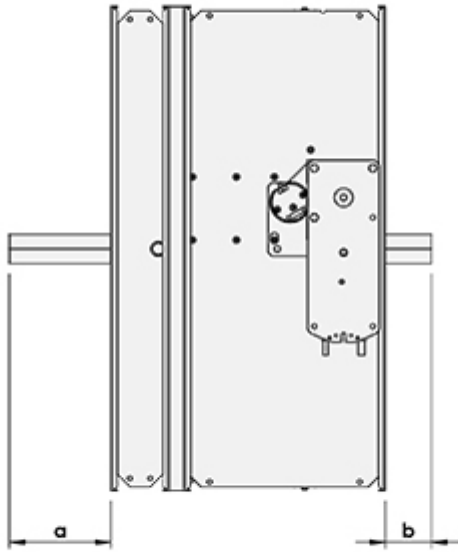

Size	a	b	Size	a	b
800 x 700	273	28	1200 x 700	273	28
800 x 800	323	78	1200 x 800	323	78
900 x 700	273	28	1300 x 700	273	28
900 x 800	323	78	1300 x 800	323	78
1000 x 700	273	28	1400 x 700	273	28
1000 x 800	323	78	1400 x 800	323	78
1100 x 700	273	28	1500 x 700	273	28
1100 x 800	323	78	1500 x 800	323	78

Weight (kg)

With electric actuator

H	W							
	800	900	1000	1100	1200	1300	1400	1500
600	–	45.0	48.0	52.0	57.0	59.5	62.0	65.5
700	46.0	50.0	54.0	57.5	63.0	65.5	68.5	72.5
800	50.0	54.5	58.5	62.5	68.5	70.5	74.5	78.5


– = Size not available

With mechanical spring release

H	W							
	800	900	1000	1100	1200	1300	1400	1500
600	–	42.0	45.0	49.0	54.0	56.5	59.0	62.5
700	43.0	47.0	51.0	54.5	60.0	62.5	65.5	69.5
800	47.0	51.5	55.5	59.5	65.5	67.5	71.5	75.5

– = Size not available

Material

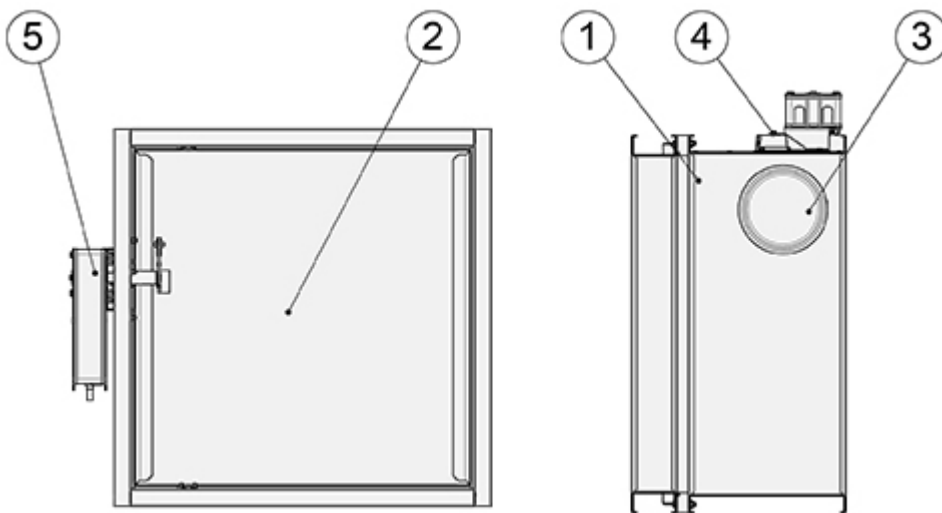

Key	Part	Material	Note
1	Casing	Galvanised steel	Stainless steel options available on request (AISI 316L)
2	Blade	Asbestos free boards made of mineral fibre	–
3	Inspection hatch covering	Galvanised steel	In case the casing is stainless steel, the covering is also stainless steel.
4	Fuse	–	Electrical model
5	Operating model (actuator)	–	Electrical model

Operating Models

Electric actuator

In the electric actuator (24 V and 230 V) system when a signal from building automation reaches the actuator or the fuse reacts to a rise in temperature (72 °C) power supply is switched off and the spring closes the damper blade. When the power supply is turned back on (e.g. during routine testing), the actuator opens the damper blade. The actuator is equipped with built-in limit switches for both open and closed position.

These actuators have a visual position indicator and fuses can be replaced from outside the device.

24 V (AC/DC)

The Halton Exe Tough Rectangular fire damper with the 24 V electric actuator option must be connected to buildings fire damper management control system. We recommend our Modbus based network solution, Halton Safe HSM management system. This system enables the use of smoke detectors in ductwork or room spaces.

Operationally, when the Halton Safe HSM receives a signal from the fire alarm or smoke detector the power supply is turned off and the spring return actuator drives the damper blade to the closed position. When the power supply is reinstated (e.g. during routine testing) the actuator drives the damper blade to open the position.

The fire damper can also be connected to other commonly used building automation systems.

230 V (AC)

The Halton Exe Tough Rectangular fire damper with the 230 V electric actuator option must be connected to buildings fire damper management control system

Order Code	Operating Model	Damper Sizes (WxH, mm)	Operating Voltage	Limit Switch
B1	BF 24-T 18 Nm	800×700 – 1500×800	AC/DC 24 V	✓
B2	BF 230-T 18 Nm	800×700 – 1500×800	AC 230 V	✓

Mechanical spring release (failsafe)

In Halton Exe Tough Rectangular fire damper with mechanical spring release, the fuse reacts to the rise of temperature (72 °C) and the mechanical spring closes the damper blade. It needs to be opened manually.

This operating model has a visual position indicator and fuses can be replaced from outside the device.

The limit switch (accessory) indicates the damper blade position. When the damper blade is open (safe position), the limit switch indicates this position. If the damper blade is closed (fail safe), the limit switch sends an impulse to the monitoring system. This system triggers an alarm and/or stops/starts fans, depending on the designed system. The limit switch has no influence on the thermal fuse or release mechanism.

The maximum operating voltage and current is 230 V, 5A.

Limit switch	LS1	Closed position indication, enclosure class IP 65
Limit switches	LS2	Open/closed position indication, enclosure class IP 65

Function

The Halton Exe Tough Rectangular fire damper is CE certified for vertical (v_e) and horizontal (h_o) installation in concrete, masonry and lightweight structures. It fulfils the fire resistance class up **EI 120 ($v_e h_o i \leftrightarrow o$) S** requirements.

General

Fire dampers are shutters in ventilation duct systems and prevent spreading of the fire and smoke from one fire department to the other. They are equipped with either an electric operating model (actuator) or mechanical spring release (failsafe). Under both options, a fuse reacts to a rise in temperature, causing a spring-return damper blade to close position.

A fire damper with electrical actuator must be connected to a common fire alarm or building automation system.

In the electric actuator (24 V or 230 V) system, when a signal from building automation reaches the

actuator or the fuse reacts to a rise in temperature (72 °C), the power supply is switched off, the spring closes the damper blade and seals the duct fire and smoke tightly. When the power supply is turned back on (e.g. during routine testing), the actuator opens the damper blade. The actuator is equipped with built-in limit switches for both open and closed position.

Alternatively, the fire damper can be delivered with a mechanical spring release (fail safe) with a fuse that reacts to the rise of temperature (72 °C) and the mechanical spring closes the damper. It needs to be opened manually.

Fire damper management system

It is recommended that the fire damper with an electrical actuator is connected to an automatic fire damper management system, e.g. Halton Safe. Testing for fire dampers can be done automatically in Halton Safe.

Only fire damper with 24 V electric actuator can be connected to the Halton Safe HSM control and testing system. This system enables the use of smoke detectors in ductwork or in the rooms.

Operationally, when the Halton Safe receives a signal from the fire alarm or smoke detector the power supply is turned off and the spring return actuator drives the damper blade to the closed position. When the power supply is reinstated (e.g. during routine testing) the actuator drives the damper blade to the open position.

The Halton Exe Tough Rectangular fire damper can also be connected to common building automation systems.

Installation

Please see/download Installation Guide for this fire damper from section Downloads.

Servicing

No regular maintenance is required for the product.

To ensure proper operation of fire dampers, inspection must be carried out regularly according to local building codes. The minimum recommended inspection period is **every 6 months**. Documentation of testing needs has to be saved for future needs.

A fire damper with electrical actuator must be connected to a common fire alarm or building automation system.

It is recommended that the fire damper with an electrical actuator is connected to an automatic fire damper management system, e.g. Halton Safe HSM with operating voltage AC 24 V. Testing for fire dampers can be done automatically in Halton Safe HSM.

The fuse of a fire damper equipped with an electric actuator must be replaced if the fuse has been

released because of a rise of temperature in the duct. The fuse can be changed from outside the fire damper.

If the fuse of a fire damper with a mechanical spring release (failsafe) is worn out, it must be replaced.

The fire damper is equipped with one inspection hatch, enabling the possibility to check the position of the damper blade. The actuators (electrical and mechanical spring release) include position indicators, open and close

Upon failure during testing of the fire damper, maintenance service shall be ordered from an authorised Halton representative to ensure appropriate operation of the product.

Specification

The fire damper is CE certified and marked according to the standard EN15650 and fire tested according EN 1366-2 standard.

A fire damper of maximum fire resistance class **EI 120 (h_o v_e i↔o) S** requirements.

The fire damper casing complies with the tightness requirements for EN 1751 class C. Leakage through closed damper blade fulfils class 2 according to EN 1751.

The casing of the fire damper is made of galvanised or stainless steel (AISI 316L).
The blade of the fire damper is made of fire resistant asbestos free board (mineral fibre).

The fire damper can be installed both vertical and horizontal position in concrete, masonry or lightweight structures.

The fire damper can be installed away from the separate element up to 1.0 metre, fulfilling fire resistance classes up to EI 90 (v_e h_o i ↔ o) S.

In all operating models (electric and mechanical spring return), the fuse shall be activated at 72 °C.

The fire damper with electric operating model includes position indicators, open and close and is equipped with built-in limit switches for both open and closed position.

The fire damper with mechanical spring release includes one position indicator (open) or two position indicators (open and closed). It can be equipped with limit switch(es), open or open and closed.

The smoke control damper is equipped with one inspection hatch, enabling the possibility to check the position of the damper blade.

Order Code

ETR-W-H; MA-OP-FU-AC-ZT

W = Width of duct connection

800, 900, 1000, 1100, 1200, 1300, 1400, 1500

H = Height of duct connection

600, 700, 800

Other options and accessories

MA = Material

GS Galvanised steel

OP = Operating model (release type)

B1 BF24-T-2 (72 °C), 18 Nm

B2 BF230-T-2 (72 °C), 18 Nm

MA Mechanical spring release (fail safe)

FU = Fuse release temperature

72 72 °C

LS = Limit switch (for mechanical spring release)

NA Not assigned

LS1 Limit switch (closed)

LS2 Limit switches (open/closed)

ZT = Tailored product

N No

Y Yes (ETO)

Code example

ETR-1000-600, OP=B1, FU=72, LS=NA, ZT=N